Ecosoft MO3TP5

Reverse Osmosis System

Piping and Instrumentation Diagram

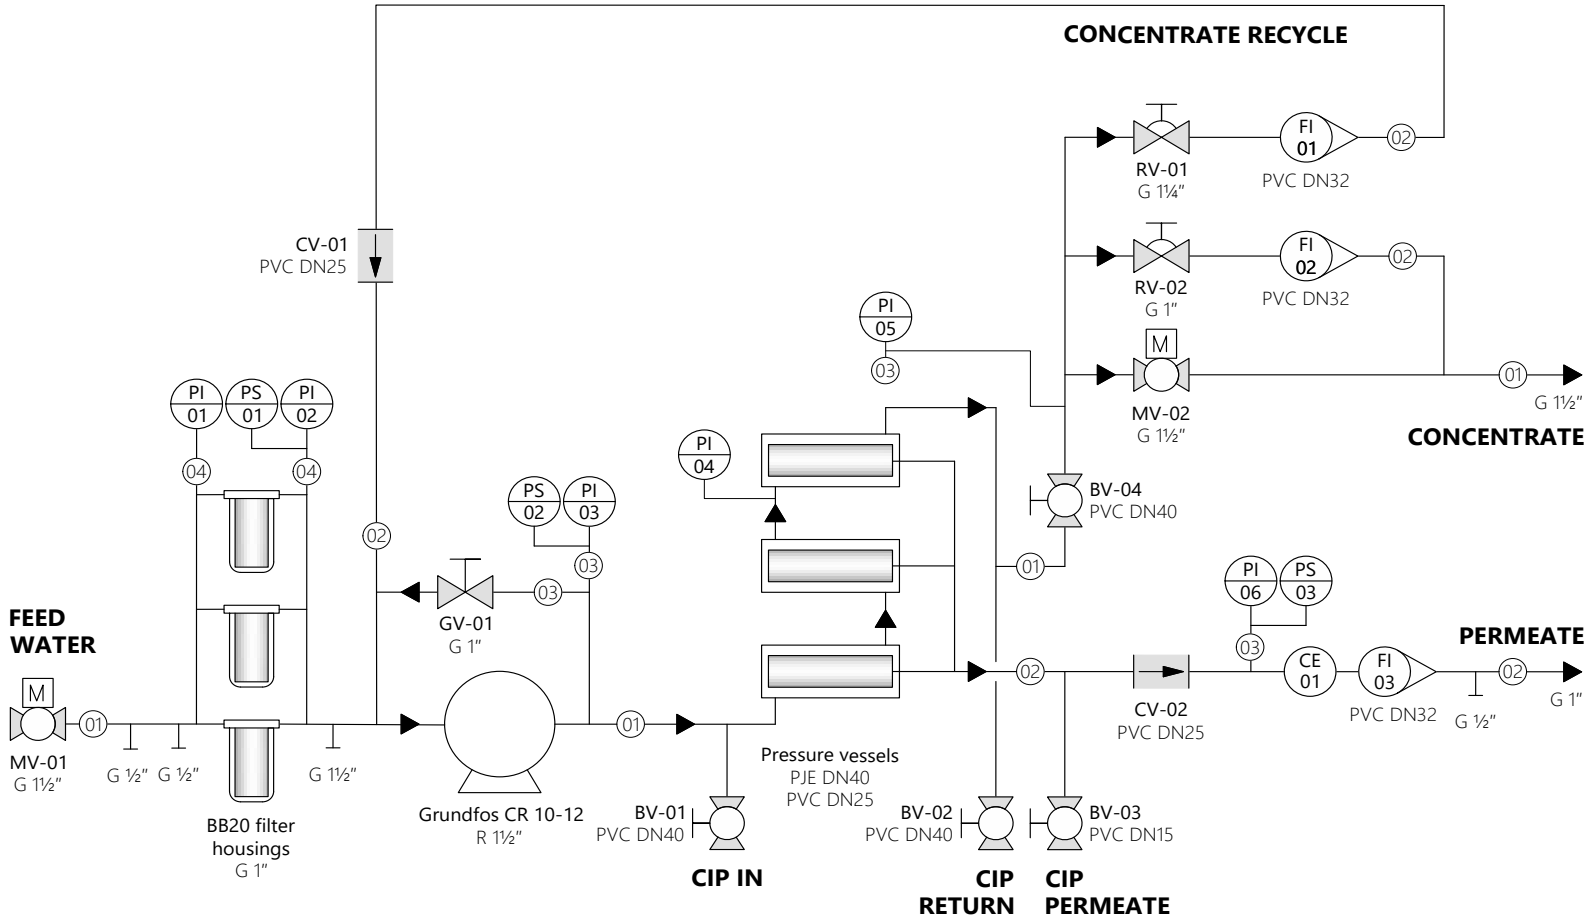

PIPE SPECIFICATIONS

01	PVC pipe	50 mm O.D.
02	PVC pipe	32 mm O.D.
03	PE hose	¼" O.D.

VALVE AND INSTRUMENT SPECIFICATIONS

- Ball Valve
- Regulating Valve
- Motorized Valve
- Pressure gauge (panel mount)
- Rotameter
- Globe Valve
- Check Valve
- Pressure switch (panel mount)
- Conductivity probe (process mount)