


Ecosoft MO16TP5
Reverse Osmosis System
Piping and Instrumentation Diagram

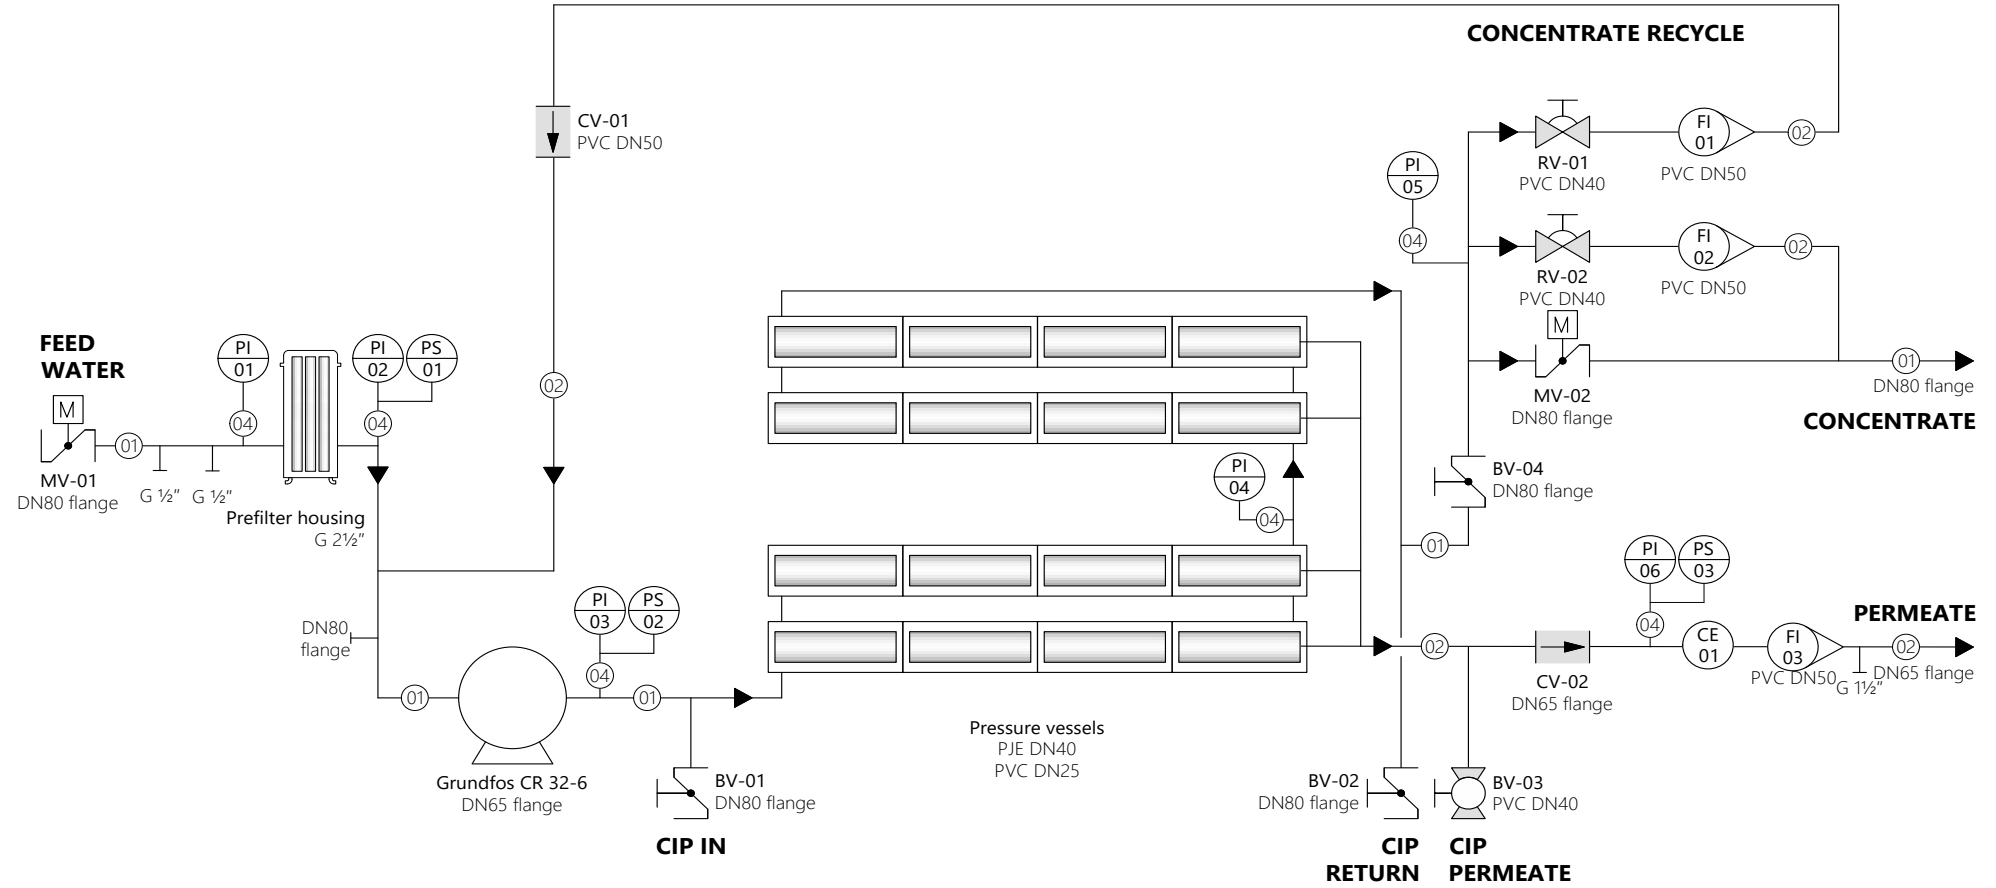

PIPE SPECIFICATIONS

- ① PVC pipe 75 mm O.D.
- ② PVC pipe 63 mm O.D.
- ③ PVC pipe 50 mm O.D.
- ④ PE hose 1/4" O.D.

VALVE AND INSTRUMENT SPECIFICATIONS

- | | | | | |
|---------------------------|-----------------|------------|-------------------------------|------------------------------------|
| Motorized butterfly valve | Diaphragm valve | Ball valve | Pressure gauge (panel mount) | Rotameter |
| Butterfly valve | Check valve | | Pressure switch (panel mount) | Conductivity probe (process mount) |